


# GC-1008

8-channel digital input module (PNP)

User manual

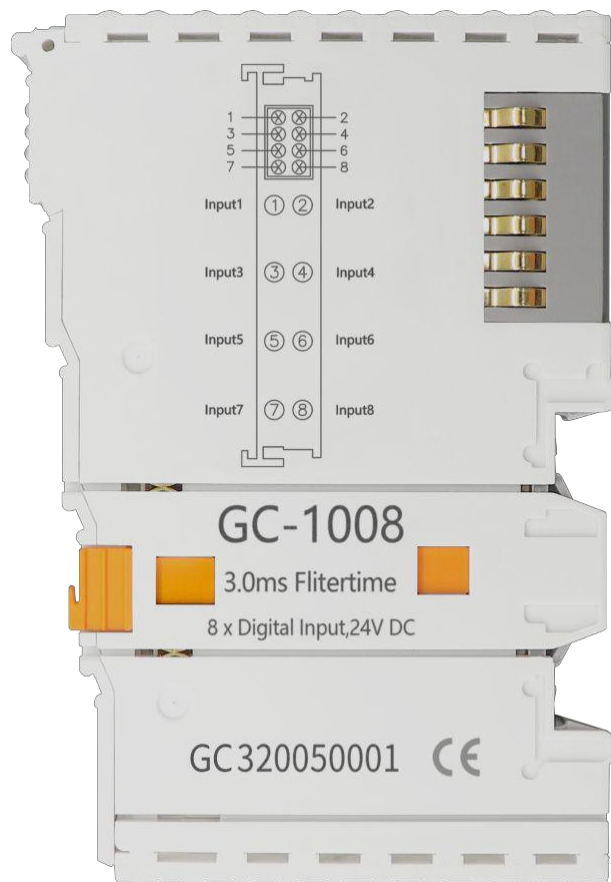

Document version 3.02 (2020/10/27)

**Revision History**

<b>Version</b>	<b>Date</b>	<b>Reason</b>
V1.00	2015/09/16	Create
V2.01	2015/12/20	Modify device parameters
V3.01	2017/10/22	Add parameters
V3.02	2020/10/27	Modify device appearance picture

## Contents

1. Introduction .....	4
1.1 Overview .....	4
1.2 Properties at a glance .....	4
1.3 Typical application .....	4
2. Installation .....	5
2.1 Module fixing .....	5
2.2 Wiring method .....	5
2.3 System status indicator .....	7
2.4 Combined with GCAN-PLC-400/510 series .....	7
2.5 Combined with GCAN- 8000 series .....	8
3. Technical Specifications .....	9
4. Disclaimer .....	10
5. Module selection table .....	11
Sales and service .....	13

# 1. Introduction

## 1.1 Overview

The GC-1008 module has integrated 8 digital input channels, which acquires digital signals in real-time and transmits them to the GCAN-PLC coupler. This module can be used with any other GC Series IO module to capture and process digital data in industrial automation or distributed control systems.

## 1.2 Properties at a glance

- 8 input channels
- Nominal voltage: 24V DC(±20%)
- Signal voltage "1":11~30V
- Signal voltage "0":-3~+5V
- Maximum input current:3mA
- Electrical isolation: 500 V(GC-bus)
- Current consumption:100mA
- The bit width input in the process image is 1byte
- No address setting, configuration via bus coupler or controller
- Operating temperature: -40°C ~+85°C
- Size: 100mm\*69mm\*12mm

## 1.3 Typical application


- Distributed acquisition system collects digital quantity
- Industrial field acquisition switch quantity

## 2. Installation

This chapter will describe the installation method, wiring method, meaning of the indicator and meaning of the interface of the GC-1008 module.

### 2.1 Module fixing

The installation method of GC-1008 module as shown in [Figure 2.1](#) and a flat-blade screwdriver is needed for auxiliary installation.

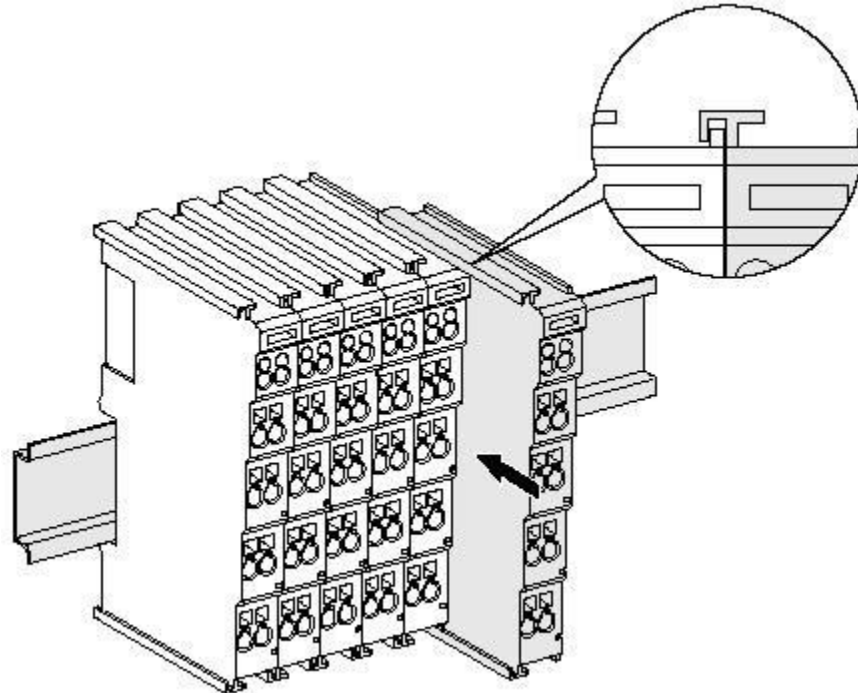

**Figure 2.1** Installation of GC-1008 module

First install the GCAN-PLC on the guide rail and plug the GC-1008 along GCAN-PLC's right side until the lock is stuck. When remove the GC-1008, the user need to release the self-locking mechanism by pulling out the orange label.

### 2.2 Wiring method

The power wiring as shown in [figure 2.2](#). First, use a flat-blade screwdriver to insert into the square hole, hold the top edge of the metal sheet in the square hole, and press toward the hole. Then, insert the wire into the hole. After plugging in, pull out the screwdriver and the wire can be firmly locked in the hole.

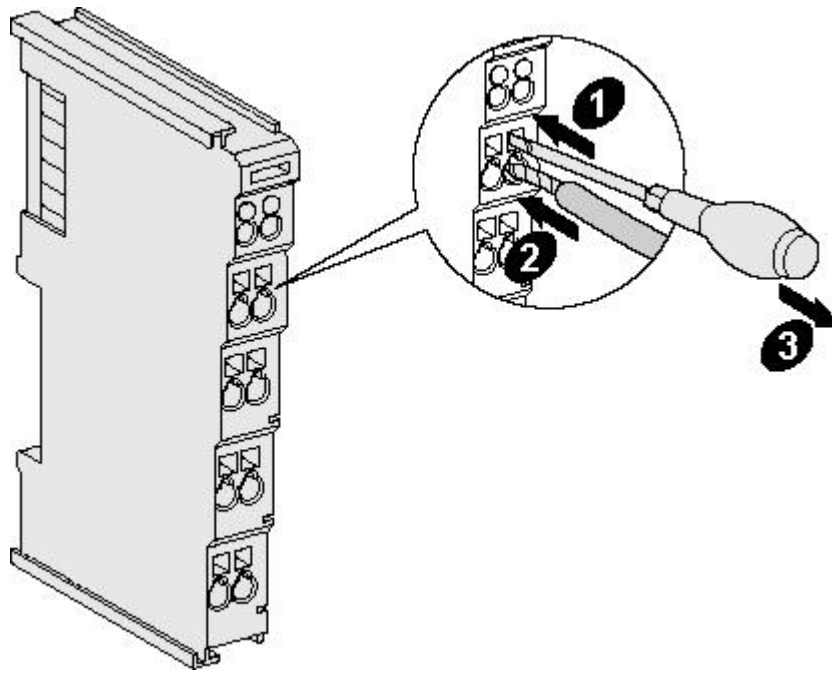


Figure 2.2 Wiring method of GC-1008 module

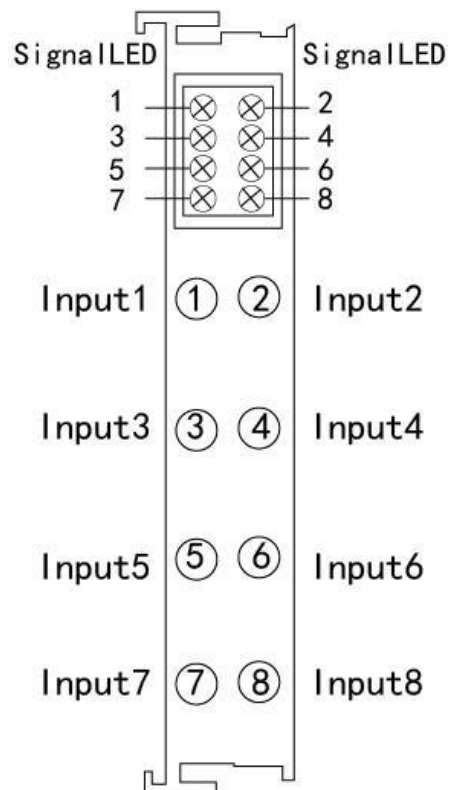


Figure 2.3 GC-1008 module terminal definition

Terminal	No.	Definition
Input1	1	Digital input 1
Input2	2	Digital input 2
Input3	3	Digital input 3
Input4	4	Digital input 4
Input5	5	Digital input 5
Input6	6	Digital input 6
Input7	7	Digital input 7
Input8	8	Digital input 8

**Table 2.1** GC-1008 module indicator

Note: When using, please connect digital input signal to the terminal of GC-1008 and connect the reference ground to the negative power supply of GCAN-PLC-400 or GCAN-IO-8000 modules (corresponding to pins 5 and 6).

### 2.3 System status indicator

Indicators	Definition
1	Digital input1 is valid.
2	Digital input 2 is valid.
3	Digital input 3 is valid.
4	Digital input 4 is valid.
5	Digital input 5 is valid.
6	Digital input 6 is valid.
7	Digital input 7 is valid.
8	Digital input 8 is valid.

**Table 2.2**

The GC-1008 module has no error indicator. The user can determine the status through the "IO RUN" and "IO ERR" indicators of the GCAN-PLC. If the "IO ERR" indicator of the GCAN-PLC lights up, it indicates that the IO module is not working properly. Please check the module installation.

### 2.4 Combined with GCAN-PLC-400/510 series

When using with GCAN-PLC-400/510, GC series IO modules shall be configured in the order of DI, DO, AI and AO, and the same type of modules shall be put together. GCAN-PLC-400/510 supports programming in five languages. The following is an example of ST language showing how to program GCAN-PLC-400 to read the state of digital input of GC-1008 module.

In the process of ST programming definition, gc-1008 module needs to define variable type, input signal position, start character, delimiter and so on.

For example: "DI0 AT%I0.0:BOOL;"

"0.0" represents the position of the input point, and "0.0"~"0.7" respectively define the 1-8 input points in the first GC-1008 module. When the user uses more than one GC-1008 module, the second GC-1008 shall be defined from "1.0" to "1.7", and so on.

"%" (percent sign) is the direct variable starter; ":" (colon) is the variable or type separator.

The Boolean is read from the %I0.0 address using the symbol variable DI0. AT represents the address of the variable access and the additional attribute of the variable.

## 2.5 Combined with GCAN- 8000 series

The state of the digital input is represented by one byte, with channel 8 in the high and channel 1 in the low.

For example, when GCAN-8000 module node number is 1, the input state of channel 8 and channel 4 of the first GC-1008 module is logic "1", and the input state of other channels is logic "0", the CAN data frame ID sent by the GCAN-IO-8000 module is 0x181, the data length(DLC) is 8, and the frame data is 0x88, 0x00, 0x00, 0x00, 0x00, 0x00, 0x00, 0x00. Please note that when only one GCAN-1008 module is inserted, only the first byte of the frame data is valid. The table below lists two common DI state and their corresponding status data.

DI status								
Channel	8	7	6	5	4	3	2	1
Status	1	0	0	0	1	0	0	0
CAN bus data	88							

DI status								
Channel	8	7	6	5	4	3	2	1
Status	0	1	0	1	1	0	1	0
CAN bus data	5A							

Table 2.3



### 3. Technical Specifications

<b>Interface characteristics</b>	
Number of inputs	8
Signal voltage "1"	11~30V
Signal voltage "0"	-3~+5V
Input current (Max.)	3mA
Electrical isolation	500 V (GC-bus/ Signal voltage)
Bit width in the process image	Input 1 byte
Installation position	In sequential order
Power supply	Powered by GCAN-PLC, current consumption 100mA
<b>Environmental testing</b>	
Operating temperature	-40℃~+85℃
Permissible relative humidity	95%RH, no condensation
EMC test	EN 55024:2011-09 EN 55022:2011-12
Vibration/shock resistance	EN 60068-2-6/EN 60068-2-27/29
EMC resistance burst/ESD	EN 61000-6-2 /EN 61000-6-4
Protection class	IP 20
<b>Basic information</b>	
Dimensions	100mm *69mm *12mm
Weight	50g

## **4. Disclaimer**

Thank you for purchasing GCAN's GCAN series of hardware and software products. GCAN is a registered trademark of Shenyang Vhandy Technology Co., Ltd. This product and manual are copyrighted by Vhandy Technology. Without permission, it is not allowed to reproduce in any form. Before using, please read this statement carefully. Once used, it is deemed to be an endorsement and acceptance of the entire content of this statement. Please strictly abide by the manual, product description and related laws, regulations, policies and guidelines to install and use the product. In the process of using the product, the user promises to be responsible for his actions and all consequences arising therefrom. Vhandy Technology will not be liable for any losses caused by improper use, installation, or modification by users. The final interpretation right of the disclaimer belongs to Vhandy Technology

## 5. Module selection table

GCAN-PLC-400 series products consist of a programmable main control module, several GC series IO modules and a terminal resistance module. GC series IO modules currently include five categories: digital input, digital output, analog input, analog output, and communication extension. The specific selection table is shown in [Table 5.1](#).

I/O	Type	Characteristic	Signal	Channel
PLC Control module	GCAN-PLC-400	CPU:168M	-	-
	GCAN-PLC-510	CPU:400M	-	-
	GCAN-PLC-511	CPU:400M (2CAN)	-	-
Digital input	GC-1008	Digital input (PNP)	24V DC	8-channel
	GC-1018	Digital input (NPN)	24V DC	8-channel
	GC-1502	Counter (200kHz max)	-	2-channel
Digital output	GC-2008	Digital output (PNP)	24V DC	8-channel
	GC-2018	Digital output (NPN)	24V DC	8-channel
	GC-2204	relay output	-	4-channel
	GC-2302	PWM (20Hz~200kHz)	-	2-channel
Analog input	GC-3604	Voltage input, 16 bits	-5~+5V	4-channel
	GC-3624	Voltage input, 16 bits	10V~+10V	4-channel
	GC-3644	Current input, 16 bits	0-20mA	4-channel
	GC-3654	Current input, 16 bits	4-20mA	4-channel
	GC-3664	Voltage input, 16 bits	0~+5V	4-channel
	GC-3674	Voltage input, 16 bits	0~+10V	4-channel
	GC-3804	2-wire PT100, 16 bits	Thermal resistance	4-channel
	GC-3822	3-wire PT100, 16 bits	Thermal resistance	2-channel

	GC-3844/3854/3864	K type / S type / T type thermocouple	Thermocouple	4-channel
Analog output	GC-4602	Voltage output, 16 bits	-5V~+5V	2-channel
	GC-4622	Voltage output, 16 bits	-10V~+10V	2-channel
	GC-4642	Current output, 16 bits	0-20mA	2-channel
	GC-4652	Current output, 16 bits	4-20mA	2-channel
	GC-4662	Voltage output, 16 bits	0~5V	2-channel
	GC-4672	Voltage output, 16 bits	0~10V	2-channel
	GC-4674	Voltage output, 12 bits	0~10V	4-channel
Special module	GC-6101	RS232/RS485 extension	-	-
	GC-6201	GPRS extension	-	-
	GC-6221	4G extension	-	-
	GC-6501	WiFi extension	-	-

**Table 5.1** Selection table

## Sales and service



Shenyang Vhandy Technology Co., Ltd.

**Address:** Room 401, D11 Block, SISP., Hunnan District, Shenyang, Liaoning, China

**E-mail:** [info@gcanbus.com](mailto:info@gcanbus.com)

**Tel/ Whatsapp:** +86-13644001762

**Website:** [gcanbus.com](http://gcanbus.com)